

4'-11"

6'-2" MIN


**PLAN** 

## NOTES


DOOR.

- OPERABLE PARTS OF DISPENSER SHALL **NOT EXCEED 48" ABOVE PARKING** SURFACE.
- **BOLLARDS ARE FOR WARNING PURPOSE** ONLY.
- FINAL FOOTING CALCULATIONS AND SIZING TO BE DETERMINED BY ENGINEER OF RECORD PRIOR TO CONSTRUCTION.
- LEAVE A MINIMUM OF 22" (560 MM) IN FRONT OF THE CHARGER FOR FRONT
- 5. LEAVE A MINIMUM OF 21.6" (550 MM) ON BOTH SIDES.
- 6. LEAVE A MINIMUM OF 8.7" (220 MM) IN THE

BACK OF THE CHARGER.

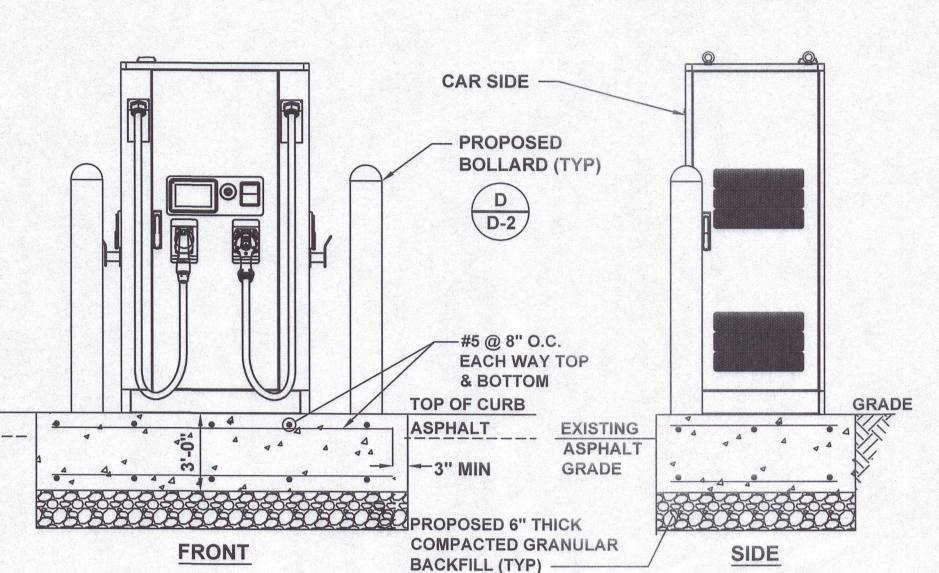

**DISPENSER FOOTING DETAIL (100KW)** 

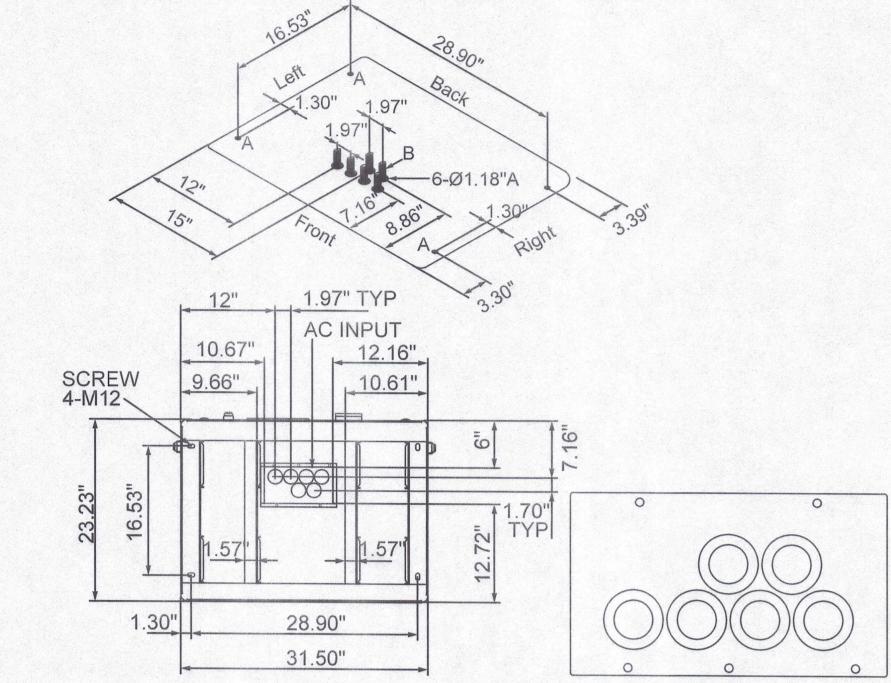

1. CONTRACTOR TO DRILL FOUR M12 HOLES FOR INSTALLING THE CHARGER. DRILL SIX 30

3. CONTRACTOR TO MAKE SURE THAT THE CABLES EMERGE FROM THE FLOOR THROUGH

2. CONTRACTOR TO DRILL AND TAP 4 HOLES (M12) INTO THE CEMENT BASE AT THE

MM (1.18")-DIAMTER HOLES WITH OR A RECTANGLE WITH A WIDTH OF 250 MM (9.84") AND A

DEPTH OF 130 MM (5.18") FOR HOLDING THE POWER CABLES AND THE ETHERNET CABLE.

CONTRACTOR TOMAKE SURE THAT A CABLE LENGTH OF 0.6M IS AVAILABLE ABOVE THE

DISPENSER ANCHORAGE AND CONDUIT ENTRY DETAIL D-1 SCALE: N.T.S.

## NOTES


DISPENSER GRADE

SIDE

D-1 SCALE: N.T.S.

CONDUIT ENTRY DETAILS.

- MINIMUM CONCRETE EDGE DISTANCE FOR PROPOSED ANCHORS SHALL BE 6".
- CONTRACTOR TO FIELD VERIFY THE ANCHOR SPACING PER MANUFACTURER'S 3. CONTRACTOR TO REFER TO THE INSTALLATION MANUAL FOR ANCHORAGE AND

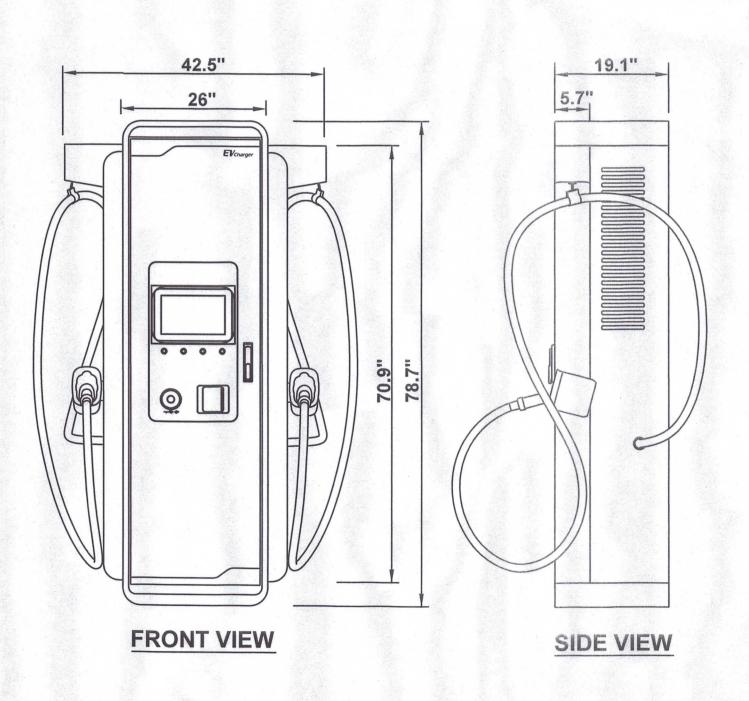

E DISPENSER DETAIL (350KW)
D-1 SCALE: N.T.S.

## NOTES


**NOTES** 

INDICATED POSITIONS (A).

THE 6 MARKED HOLES (B).

FLOOR FOR INTERNAL ROUTING IN THE CABINET.

- MINIMUM CONCRETE EDGE DISTANCE FOR PROPOSED ANCHORS SHALL BE 6".
- CONTRACTOR TO FIELD VERIFY THE ANCHOR SPACING PER MANUFACTURER'S **INSTALLATION MANUAL**
- CONTRACTOR TO REFER TO THE INSTALLATION MANUAL FOR ANCHORAGE AND CONDUIT ENTRY DETAILS.

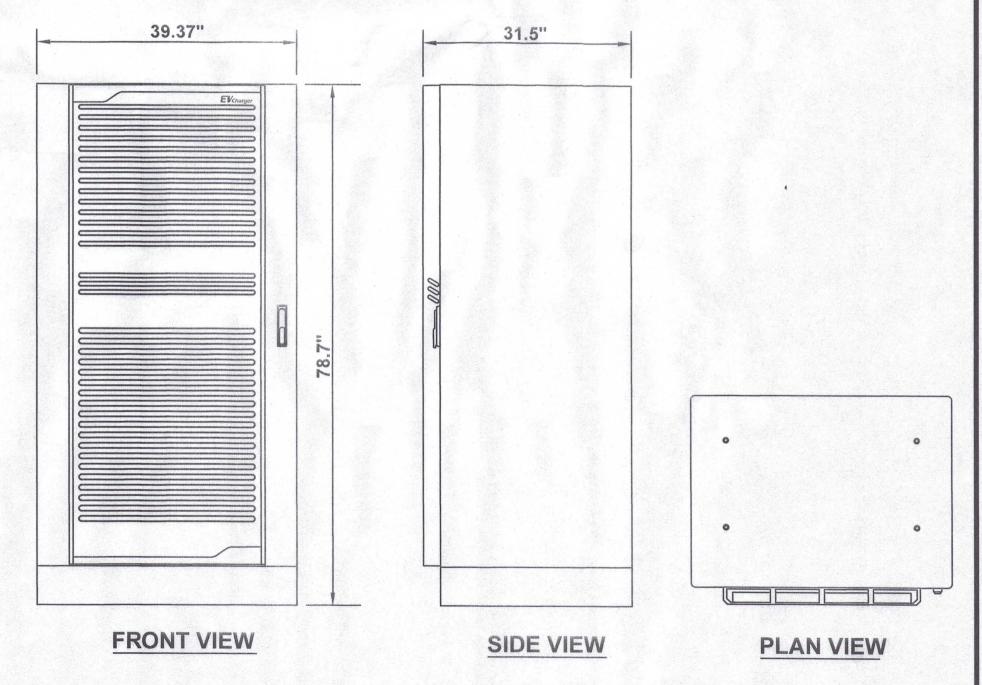

F POWER CABINET DETAIL (350KW)
D-1 SCALE: N.T.S.



EVgo SERVICES, LLC 11835 W OLYMPIC BLVD STE 900 E LOS ANGELES, CA 90064





WAWA #0157 **NORTH WALES** 


593 DEKALB PIKE. -EV NORTH WALES,PA 19454

SHEET DESCRIPTION: DETAILS



Project #: P17773

2022.07.25 - DD100 PRELIMINARY DESIGN

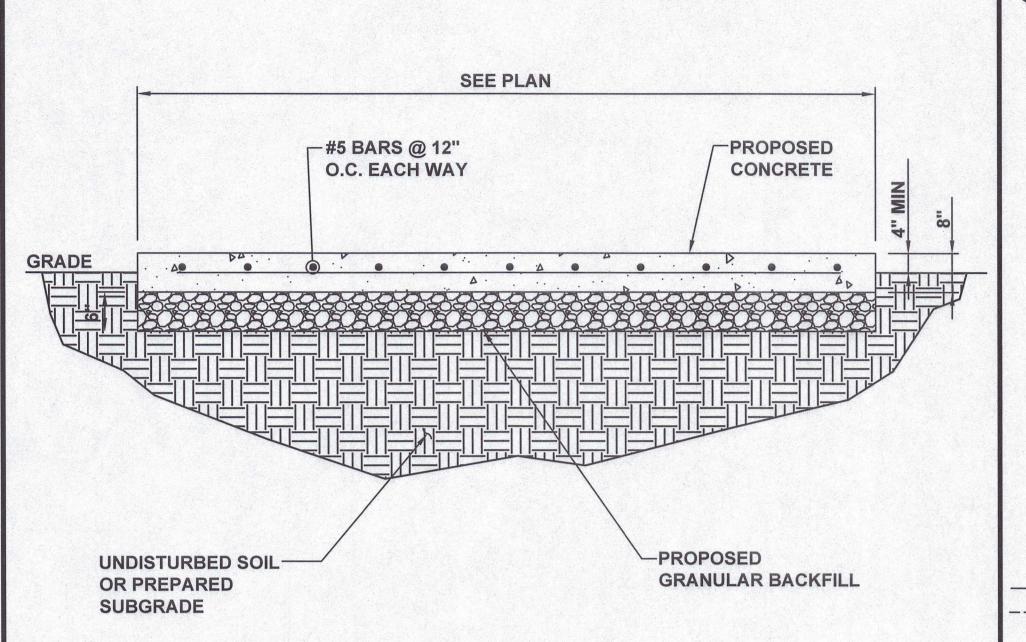


D-1 SCALE: N.T.S. 5'-0" MIN **NOTES** 

**CONCRETE PAD DETAIL** 

**EXCEED 48" ABOVE PARKING** SURFACE. 2. BOLLARDS ARE FOR

1. OPERABLE PARTS OF

DISPENSER SHALL NOT

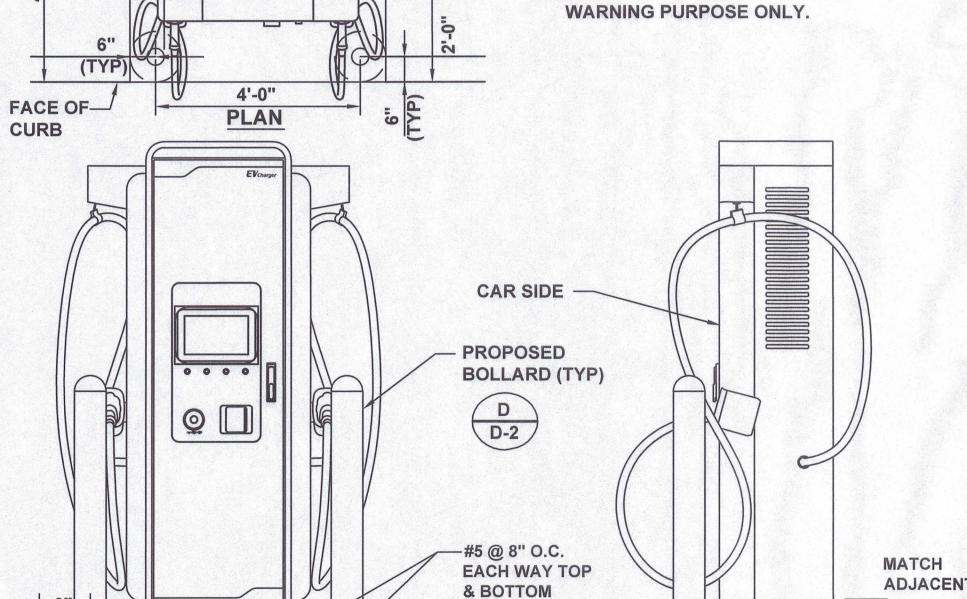

**DELTA DISPENSER FOOTING DETAIL (350KW)** D-1 SCALE: N.T.S.

BACKFILL (TYP)

PROPOSED 6" THICK

**COMPACTED GRANULAR** 

EXISTING

GRADE

**FRONT**